

# A NEURAL NETWORK-BASED METHOD FOR GAS TURBINE BLADING FAULT DIAGNOSIS

C. Angelakis<sup>3</sup>, E. N. Loukis<sup>2</sup>, A. D. Pouliezos<sup>3</sup>, G. S. Stavrakakis<sup>1</sup>

<sup>1</sup>Technical University of Crete, Dept. of Electronic and Computer Engineering, Hania 73100, Crete, Greece

<sup>2</sup>University of Aegean, Dept. of Information and Communication Systems, Karlovassi 83200, Samos, Greece

<sup>3</sup>Technical University of Crete, Dept. of Production Engineering and Management, Hania 73100, Crete, Greece

**Key Words:** Fault Diagnosis, Gas Turbines, Neural Network Architectures.

## Abstract

In this paper artificial neural networks are used with promising results in a critical and at the same time very difficult problem concerning the diagnosis of Gas Turbines blading faults. Neural network-based fault diagnosis is treated as a Pattern Recognition problem, based on measurements and feature selection. Emphasis is given on the design of the appropriate neural network architecture and the selection of the appropriate measuring instruments, which are of critical importance for achieving good performance (high success rates and generalization capabilities). Initially the performance of the classical neural network architectures, namely MultiLayer Perceptron (MLP), Learning Vector Quantization (LVQ), Modular MultiLayer Perceptron and Radial Basis Function (RBF), is investigated for this problem. The implemented neural network structures are trained to classify faulty and healthy patterns coming from twelve different measuring instruments. The performance of the above neural network structures is investigated, and the diagnostic capabilities of the measuring instruments are examined. Next, in order to improve the generalization capabilities, which are critical for the specific diagnostic problem, a new multinet architecture is developed, based on the idea of "Majority Rule" decision. Compared with the classical architectures, this new multinet architecture is characterized by higher generalization capabilities and robustness. A first approach to the design of the appropriate multinet architecture and the selection of the appropriate measuring instruments in order to provide the basis of a high performance automated diagnostic system, is proposed. The conclusions derived are of more general interest and applicability.

## 1. Introduction

Development of effective Gas Turbine Condition Monitoring and Fault Diagnosis methods has been the target of considerable research in recent years. This is due to the high cost, sensitivity and importance of these engines for most industrial companies. Most of this research is directed towards the diagnosis of Gas Turbine blading faults, because of the catastrophic consequences that these faults

can have, if they are not diagnosed in time. Even very small blading faults can very rapidly grow and result to huge destructions ([1], [2], [3]). Blading faults diagnosis is regarded to be a very difficult problem, because of the high levels of noise in all relevant measurements and the high interaction between the numerous Gas Turbine blading rows. Therefore, it is very important to take advantage of the processing power of modern computers, in order to provide a fast and reliable engine condition diagnosis from available measurements and to develop the highest possible level of intelligence and assistance to the operation and maintenance personnel.

The Gas Turbine Blading Fault Diagnosis problem was originally addressed in [4] and [5] based on classical pattern recognition methods. In the present paper a neural network approach is developed for this problem. A number of different neural network architectures are implemented for the classification of faulty and healthy patterns, coming from twelve different measuring instruments. The first purpose of this work is to evaluate the suitability of the various neural network architectures for this important and difficult diagnostic problem. Among the evaluated architectures are included both the classical ones (MLP, LVQ, RBF) and a new multinet architecture based on the idea of the 'Majority Rule' decision [6]. The second purpose is to evaluate the diagnostic abilities of the investigated measuring instruments for neural network (NN) - based diagnosis. The above evaluations also include the generalizing abilities of the implemented NN architectures, a very important issue that has not been examined in the original approach. The third purpose of this work is to suggest a way of selecting the most appropriate neural network architectures and measuring instruments in order to provide the basis of an effective automated diagnostic system.

The outline of the paper is as follows: in Section 2, the Gas Turbine Blading Fault Diagnosis problem is described, as well as the specific faults to be diagnosed and the type of instrumentation and measurements used. In Section 3, the preprocessing of the measurement data is

described, from which the corresponding pattern (feature vector) is calculated. In Section 4, the implementation of the neural network approach to the Blading Fault Diagnosis problem is described. In Section 5, the application of the classical neural network architectures to the Gas Turbine Fault Diagnosis problem is presented and the obtained results are evaluated. In Section 6, a new multinet architecture is developed and evaluated. Finally, the conclusions derived from this work are given in Section 7.

## 2. The Gas Turbine Blading Fault Diagnosis Problem

The present work is based on data acquired from dynamic measurements on an industrial gas turbine into which different faults were artificially introduced [1]. During the experimental phase four categories of measurements were performed simultaneously:

- Unsteady internal wall pressure (using fast response transducers P2 to P5)
- Casing vibration (using accelerometers A1 to A6 mounted to the outside compressor casing)
- Shaft displacement at compressor bearings (using transducer B)
- Sound pressure levels (using double-layer microphone M)

A schematic of the gas turbine illustrating the arrangement of the measuring instruments is shown in Fig. 1.

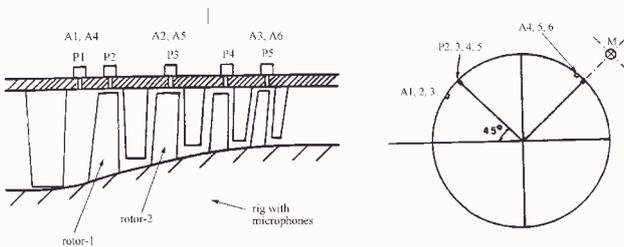


Figure 1. Arrangement of the measuring instruments

Five experiments were performed, testing the datum healthy engine and a similar engine with the following four typical small (but quite rapidly growing, as mentioned in the Introduction) and also not easily diagnosable faults:

- Fault-1: Rotor fouling
- Fault-2: Individual rotor blade fouling
- Fault-3: Individual rotor blade twisted (by appr. 8 degs.)
- Fault-4: Stator blade restaggering

Tests were performed at four different engine loads (full load, half load, quarter load and no load), both for the healthy engine as well as for the above four faults. At each load, four series of time-domain data were acquired for each instrument (two series in each of the two sampling frequencies,  $l = 13$  kHz and  $m = 32$  kHz).

## 3. Preprocessing

Based on the conclusions of [1] and [2] the fault signatures were initially calculated in the form of spectral difference patterns, defined by the following expression:

$$P(f) = 20[\log(sp(f)) - \log(sph(f))] \quad (1)$$

where  $P(f)$  is the spectral difference pattern, which is a function of frequency  $f$ ,  $sp(f)$  is the power spectrum of the signal of the measuring instrument from a faulty engine, and  $sph(f)$  is the signal spectrum from a healthy engine at the same load, sampling frequency and measurement series. Also, according to the conclusions of [1] and [2], the most useful diagnostic information is contained at the harmonics of the shaft rotational frequency. This led to filtering out the values of  $P(f)$  at frequencies other than the shaft rotational frequency harmonics. The resulting pattern from this filtering,  $Pr(f)$ , is referred to as reduced spectral difference pattern (and for simplicity 'pattern' in the following), and is given by the following equation:

$$Pr(f) = P(f)H(f) \quad (2)$$

where  $H(f) = 1$ , if  $f$  is a rotational harmonic, and  $H(f) = 0$ , for all other frequencies. Patterns were calculated for frequencies up to the 27-th harmonic of the shaft rotational frequency, i.e. patterns belong to a 27-dimensional space. An example of the pattern calculation procedure described above is shown in Fig. 2 for power spectra of unsteady pressure transducer P2.

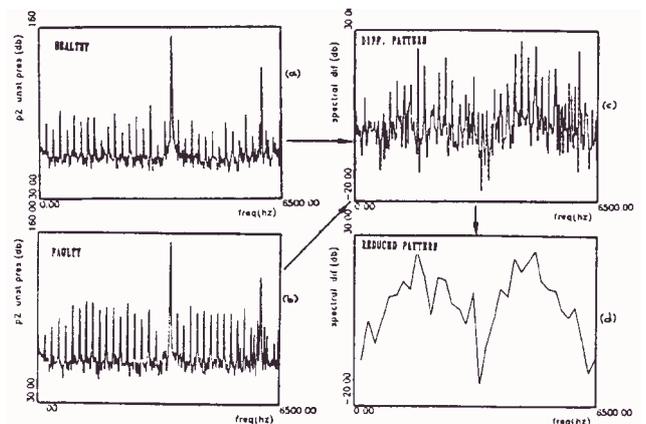


Figure 2. Pattern calculation procedure for power spectra of unsteady pressure transducer P2.

## 4. Implementation of the Neural Network Approach

### 4.1 Characteristics of the Neural Network Architectures

The neural network (NN) architectures initially selected for the Blading Fault Diagnosis problem (MLP, LVQ, RBF) have different structures and use different training algorithms. They all belong to the family of feedforward neural networks, and also have the same input and output

layer dimensions. Input layer dimension,  $k$ , equals the one of the pattern space, that is  $k = 27$ . Output layer dimension,  $n_c$ , equals the number of pattern classes representing healthy and faulty engine conditions, that is  $n_c = 5$ . Each network output neuron, when active, corresponds to a specific engine condition. The mapping of pattern classes to output neurons is as shown below in Table 1.

**Table 1**  
Mapping of pattern classes to output neurons

output neuron	1	2	3	4	5
Class	Healthy engine	Fault-1	Fault-2	Fault-3	Fault-4

In the implemented MLP structures, target values for a pattern belonging in the  $i$ -th class,  $i = 1, 2, 3, 4, 5$ , are set to 0.9 (active) for the  $i$ -th output neuron and to 0.1 (inactive) for all other neurons. Use of upper and lower threshold values was adopted in the interpretation of the continuous MLP network outputs, in order to increase the reliability of the classifications, but at the price of lower success rates. Namely, a pattern is classified to the  $i$ -th class, if the output of the  $i$ -th neuron is greater than  $T1 = 0.8$  and all other neurons have activation values below the threshold  $T2 = 0.2$ . If this is not happening for any of the classes, the pattern is rejected i.e. cannot be reliably classified to any of the classes. This scheme is similar to the T1&T2 rule described in [6] and will be referred to as T1&T2 in the present work also. The T1&T2 scheme adopted for the classification of the input patterns cannot deal with multiple-fault conditions. The situation of simultaneous multiple faults has not been considered in the work presented in this paper, since it is highly unlikely in practice and also no training data were available for such faults.

For reasons of simplicity and uniform interpretation of classification results, target output values for the RBF structures are set to those of the MLP structures. The same holds regarding the use of the T1&T2 classification scheme. LVQ networks have binary output neuron transfer functions. Output values for a pattern classified in the  $i$ -th class, are equal to 1 (active) for the  $i$ -th output neuron and to 0 (inactive) for all other neurons. Therefore, a pattern rejection scheme based on network output values cannot be applied in the case of the LVQ network architecture.

#### 4.2 Selection of Training and Test Pattern Sets

In practical situations, where the cost of measurements is high, we are very much interested in the ability of a trained neural network to generalize successfully. In order to examine the generalization abilities of the implemented network architectures, the complete pattern set of each instrument was divided in two complementing subsets. The first subset, formed by 63 patterns (7 healthy plus 14 for each fault) selected randomly out of the 72 patterns of the complete set was used as the training set, while its complement formed by the remaining 9 patterns (1 healthy plus 2 for each fault) was used as the test set for the specific instrument.

### 5. Results of Gas Turbine Fault Diagnosis with Neural Networks

#### 5.1 MLP architecture

For each of the twelve measuring instruments a three-layered feedforward NN structure was trained to classify patterns by means of a fast backpropagation algorithm with epoch training, momentum and adaptive learning rate ([7], [8], [9]). The use of more hidden layers was investigated, but it was found that one hidden layer with dimension  $h = 10$  was sufficient for the specific learning tasks. The logistic sigmoid was used as transfer function for the hidden and output layer neurons, because it was found to give the best results in terms of training speed, compared to the alternatives of hyperbolic tangent for both layers, or a combination of hyperbolic tangent and logistic sigmoid transfer functions. Network weights and biases for both hidden and output layers were initialized randomly from a uniform distribution in the interval  $[-0.5, 0.5]$ . The training procedure was considered successfully completed when the summed square error between actual and desired network outputs over the training set reached a predefined error goal value. An error goal value of 0.05 has been experimentally found to be satisfactory for the specific learning tasks. A schematic diagram of the MLP architecture is shown in Fig. 3.

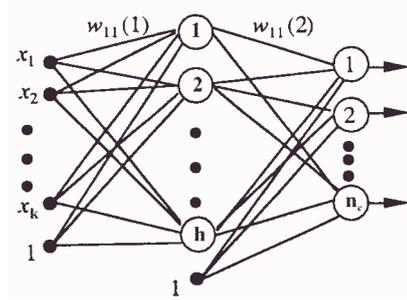


Figure 3. MLP neural network architecture.

The required training times for all implemented structures were, in the order of a few minutes. The classification success rates over the training set, the test set and the complete patterns set for all the twelve instruments using the MLP architecture are shown in Fig. 4.

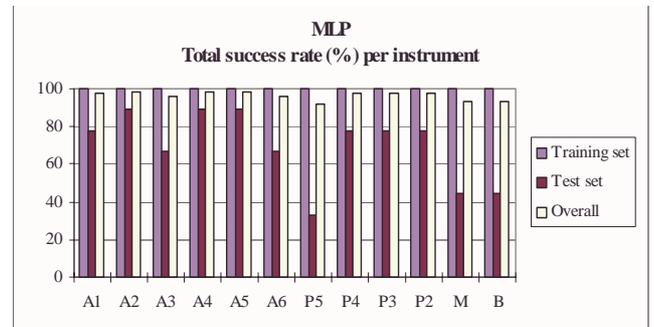


Figure 4. Total classification success rates for the MLP architecture

It can be seen that the rates of success over the training set are very high and reach 100% for all instruments. This is not the case when the test set is considered, where success rates are poor, varying from 33.3% for instrument P5 to 88.9% for instruments A2, A4 and A5. Therefore, the generalizing capabilities of this architecture are poor. The overall classification success rates (considering the complete patterns set) vary from 91.7% for instrument P5 to 98.6% for instruments A2, A4 and A5. The classification success rates, obtained over the complete pattern set for the twelve instruments for each of the five different pattern classes, are presented in Fig. 5.

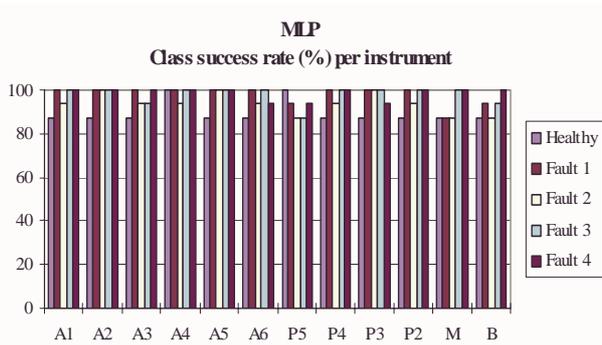


Figure 5. Classification success rates per class for the MLP architecture.

These class success rates are a quantitative measure of the diagnostic abilities of each instrument for each fault, when the MLP architecture is used. It can be seen that the healthy class is characterized by the lower success rate in nearly all instruments (except P5), therefore by using the MLP architecture there is a high probability of false alarms.

## 5.2 LVQ Architecture

In order to improve the generalizing capabilities, a feed-forward NN structure, trained with the Learning Vector Quantization (LVQ) algorithm ([8], [9]) was implemented for each of the twelve measuring instruments. Network initial weight (class reference) vectors were randomly selected among training set patterns of the corresponding class. The learning rate parameter was set to  $\eta(t) = \eta(0) = 0.01, \forall t$ . Training was accomplished by random presentation of patterns up to a maximum number of 5000 presentations. A schematic diagram of the LVQ architecture is shown in Fig. 6.

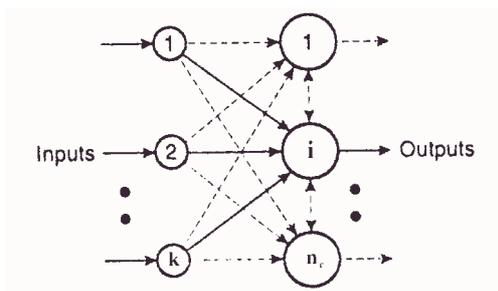


Figure 6. LVQ neural network architecture

Training times obtained for this value of maximum number of presentations were much smaller than in the MLP architecture for all implemented structures (in the order of 100 seconds). The classification success rates over the training set, the test set and the complete pattern set for the twelve instruments using the above LVQ architecture are shown in Fig. 7.

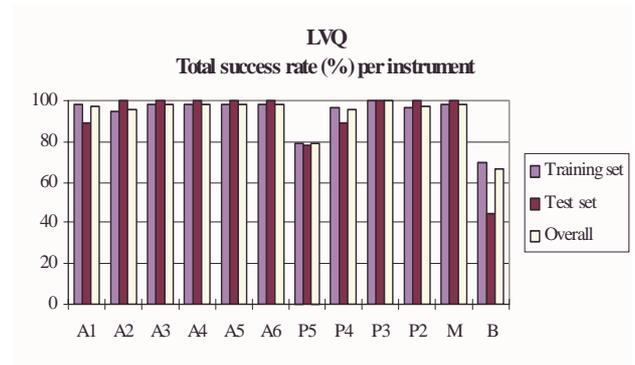


Figure 7. Total classification success rates for the LVQ architecture.

It can be seen that the rates of success over the training set are lower than in the MLP architecture and take values above 95% for all instruments, except P5 and B (with success rate values of 79.4% and 69.8%, respectively). However, the rates of success over the test set are much higher than in the MLP architecture, taking values from 88.9% to 100% for all instruments, except for P5 and B (whose success rates are 77.8% and 44.4%, respectively). Therefore the generalizing ability of successfully trained LVQ network architectures is much better compared with the MLP architecture, a fact anticipated due to the simplicity of the LVQ architecture. However the performance of the LVQ architecture in the training set is lower than the MLP architecture. The overall success rates over the complete pattern set take values above 95% for all instruments, except for P5 and B (whose success rates are 79% and 66.7%, respectively).

The classification success rates obtained over the complete pattern set for the twelve instruments for each of the five different pattern classes are presented in Fig. 8.

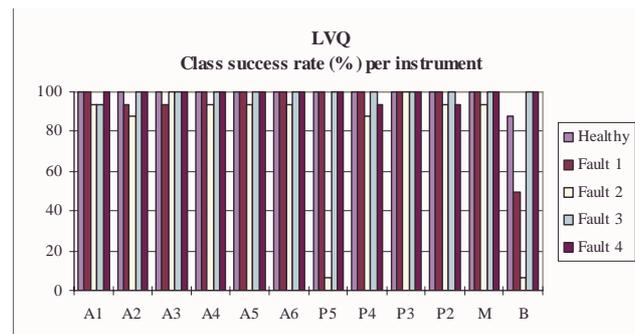


Figure 8. Classification success rates per class for the LVQ architecture.

It can be observed that the success rate achieved for healthy class, as well as for faulty classes, are in most of the cases high. We can see that instrument P5 has a very low success rate in recognizing patterns of Fault-2 (which is not a severe fault), which is responsible for the low overall success rate achieved by this instrument. Also we can see that instrument B has a very low success rate in recognizing Fault-2 patterns, and also Fault-1 patterns (another not very severe fault), which is responsible for the low overall success rate achieved by instrument B. The reason of these failures lies in the unsupervised nature of the LVQ training algorithm allowing for self-organization, that may not be successful for the case of less severe faults, even for training set patterns. Therefore, the LVQ architecture is not suitable for diagnosing less severe faults.

### 5.3 Modular MLP architecture

In order to overcome the problems of the architectures examined in 5.1 and 5.2, a modular NN structure [10], consisting of two individual MLP networks, was implemented for each of the twelve measuring instruments. The first module is a single-output MLP network, trained to distinguish between healthy and faulty patterns, while the second module is trained to classify faulty patterns in the right class. The network structures of these modules (hidden layer dimensions - neuron transfer functions), as well as the initial weights and biases, were selected as described in 5.1 for the non-modular MLP architecture. It was found that for both modules a three-layered structure, with a dimension of  $h=5$  for the hidden layer, was sufficient. Likewise, training was accomplished for each module by means of the aforementioned fast backpropagation algorithm. Error goal values of 0.02 and 0.05 for the first and the second module, respectively, were experimentally found to be satisfactory. A schematic diagram of the modular MLP architecture is shown in Fig. 9.

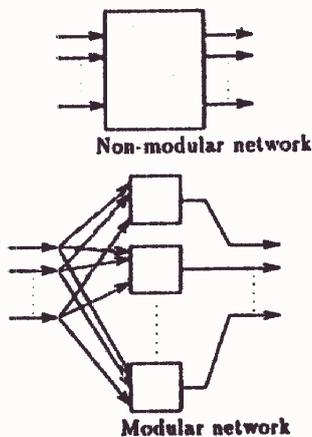


Figure 9. Modular neural network architecture

Training times were in the order of seconds for all first module structures, as expected from the small network dimensions. For the second module structures training times were also small, similar to those of the corresponding non-modular MLP structures. The classification success rates over the training set, the test set and the complete patterns set for the twelve instruments are presented in Fig. 10.

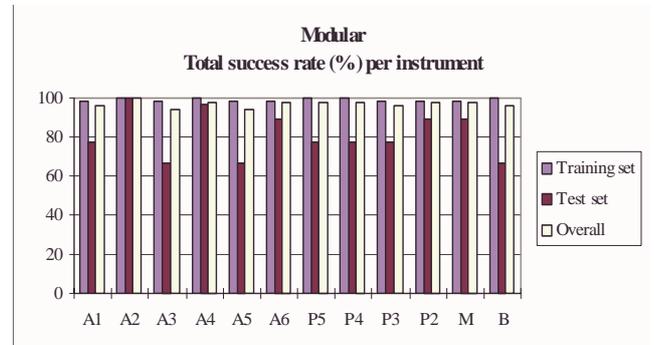


Figure 10. Total classification rates for the modular architecture.

We can see that success rate values over the training set are generally high, above 98% for all instruments. Also the success rates over the test set are higher than those of the simple MLP architecture, but lower than those of the LVQ architecture, taking values in the range of 66.7%, for instruments A3, A5 and B, to 100% for instrument A2. Success rates over the complete pattern set are generally good, taking values above 94% for all instruments. The classification success rates obtained over the complete pattern set for the twelve instruments for each of the five different pattern classes are presented in Fig. 11.

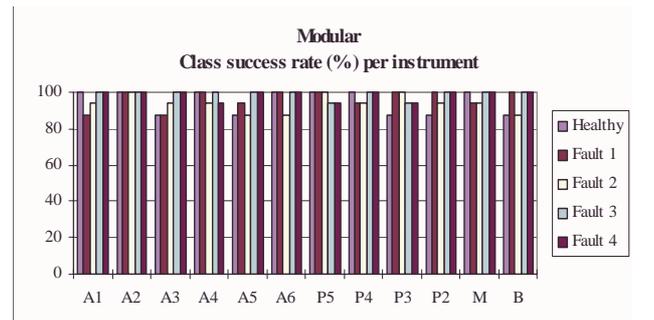


Figure 11. Classification success rates per class for the Modular architecture.

We can see that with this architecture, we do not encounter the problem of low success rates for instruments P5 and B for the less severe Fault-2, which we had with the LVQ architecture. Therefore, this architecture is much better than LVQ in diagnosing less severe faults.

From the results presented above it can be concluded that the modular MLP approach shows an overall satisfactory performance, offering improved generalization abilities in comparison to the MLP approach (see Fig. 1 and

Fig. 5). Therefore the specialization of structures results in a significant improvement of the overall performance.

#### 5.4 Radial Basis Function Architecture

A Radial Basis Function (RBF) network architecture ([9], [11]), designed with the Orthogonal Least Squares (OLS) algorithm [12], was also implemented for each measuring instrument. The objective was to examine if with this architecture a better performance can be achieved, than with the other architectures previously examined in 5.1 to 5.3. Gaussian functions of the form,

$$\varphi_j(x) = \exp\left(-\frac{\|x - \sigma_j\|^2}{2\sigma_j^2}\right) \quad (3)$$

were added sequentially to the network's hidden layer until an acceptable representation error over the training set is achieved. Their centers  $\mu_j$  were selected among the training set patterns. A summed-square error goal value of 0.05 for all implemented structures was adopted experimentally as an acceptable representation index. The values of variance  $\sigma_j$  suitable for the specific problem had to be found experimentally by the designer. A value of variance  $\sigma_j$  was selected so that the spread (distance between 0.5 cross-overs) of the basis functions was set to 60. The need for such wide spread basis functions can be explained by the necessity to span the 27-dimensional input space with a relatively small number of available training patterns. A schematic diagram of the RBF architecture is shown in Fig. 12.

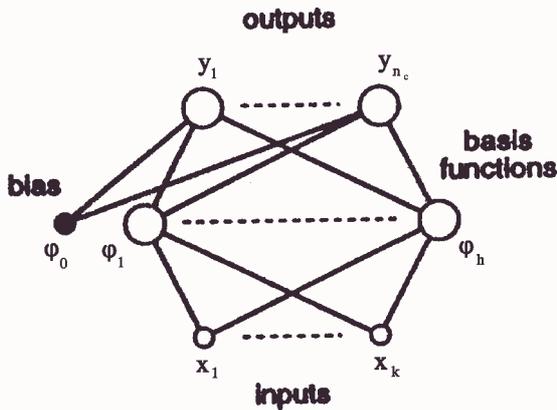


Figure 12. RBF neural network architecture.

The number of basis functions needed to design a network of satisfactory performance ranged from  $h=40$  (for instrument P2) to  $h=58$  (for instruments P4 and P5), corresponding to training times of 40 and 75 seconds, respectively. The classification success rates obtained over the training, the test and the complete patterns set for the twelve instruments with the implemented RBF network architectures are shown in Fig. 13.

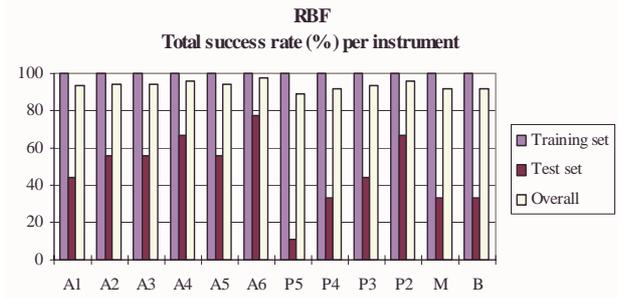


Figure 13. Total classification success rates for the RBF architecture.

We can see that the rate of success for the training set patterns reaches 100% for all instruments. However, the success rates over the test set are much lower and only for 3 out of the 12 instruments exceed 66%, showing an overall poor generalization performance. A possible reason for this is the inadequacy of the training set population related to the high dimensional pattern space. RBF networks construct local approximations to nonlinear input-output mapping and therefore may not be able to generalize well in regions of the pattern space where no training data are available. The overall classification success rates for the complete pattern set vary from 88.9% (for instrument P5) to 97.2% (for instrument A6). The classification success rates obtained over the complete pattern set for the twelve instruments for the five different pattern classes are presented in Fig. 14.

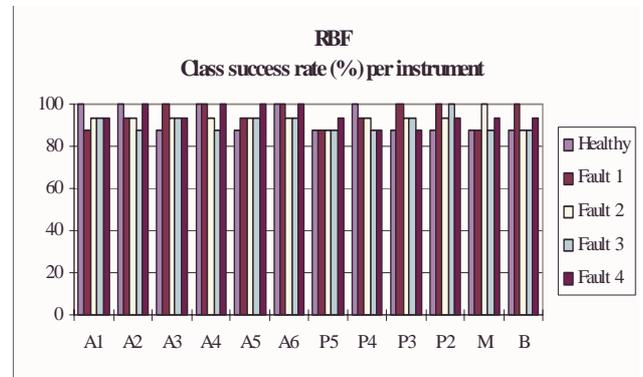


Figure 14. Classification success rates per class for the RBF architecture.

## 6. Development of a Multinet Architecture for Automated Diagnosis

The basic requirement for an efficient diagnostic system is to provide detailed diagnostic information with the highest possible reliability, with the least possible training (because the measurements required for this training are usually very costly) and the highest possible generalization capabilities. In case of a NN-based diagnostic system, the level of satisfaction of the above requirement for a specific problem depends critically on the selection of the measur-

ing instruments and NN architectures most suitable for this problem.

For the Gas Turbine Blading Fault Diagnosis problem, which is studied in the present paper, a first step towards the development of an efficient NN-based diagnostic system could be the selection of this particular "measuring instrument/NN architecture" scheme, achieving the highest overall classification success rate over the complete patterns set. From the results obtained in the previous sections it was observed that the use of an LVQ architecture for instrument P3 or the use of a Modular MLP architecture for instrument A2 lead to an overall success rate of 100% (see Fig. 3 and Fig. 5, respectively). Between these two schemes, the "A2/Modular" scheme should be finally selected, because the external measurement A2 of the casing vibration is much easier and less costly to be implemented than the internal measurement P3 of the unsteady pressure.

In order to study in more detail the generalization capabilities of the above selected diagnostic scheme, an alternative training procedure was carried out with a smaller training set. In this procedure, the training set was formed by 54 patterns (6 healthy plus 12 for each fault) selected randomly from the complete pattern set, while the remaining 18 patterns (2 healthy plus 4 for each fault) composed the test set. Because of this reduction of the training set (54 patterns instead of the initial 63 patterns), the diagnostic task becomes now more difficult.

The classification success rates obtained over the training set and the complete pattern set for the five different pattern classes using the above "A2/Modular" scheme are shown in Fig. 15.

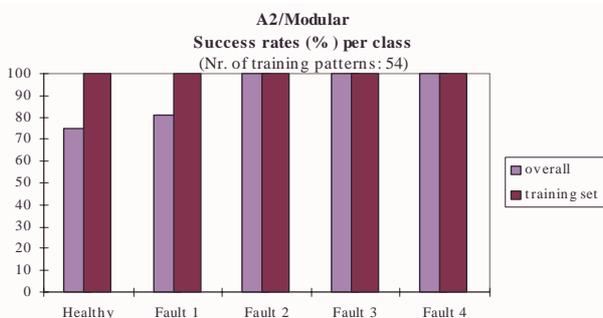


Figure 15. Performance of the "A2/Modular" scheme for a smaller training set.

It can be observed that the classification success rates for Healthy and Fault-1 patterns over the complete pattern set decrease significantly and reach 75% and 81%, respectively. This result shows that the reliability of the "A2/Modular NN"-based diagnostic system decreases significantly if the training set becomes smaller.

In order to achieve high performance and generalization capabilities with small training sets (which is usually the case in the industrial reality), a more flexible approach to the development of a NN-based system for the Gas Turbine Blading Fault Diagnosis problem (and generally for

all highly complex and difficult diagnostic problems) can be adopted, based on the synthetic use of a small number of "measuring instrument/NN architecture" schemes with complementing diagnostic abilities.

The main criteria for the selection of measuring instruments should be the maximization of diagnostic performance and the minimization of the total instrumentation cost (both initial and maintenance cost). This practically means that a small number of easy measurements, which are sensitive to the fault we want to diagnose, should be selected. In our specific problem, casing vibration, emitted sound and shaft displacement at the compressor bearings are measurements easy to implement (the latter being one of the most usual diagnostic measurements in Gas Turbines), and also as concluded in the previous sections, sensitive to blading faults. Therefore, accelerometers, microphone and bearing instruments were selected in order to develop the NN-based diagnostic system.

Concerning the selection of NN architectures, as it was concluded in Section 5, NN architectures trained with supervised learning algorithms (MLP, Modular MLP, RBF) achieve successful classification of training set patterns at rates reaching 100%, while successfully trained LVQ architectures possess very good generalization properties. Also, RBF networks trained with the OLS method are characterized by the easiest and most straightforward design and training procedure among all the examined supervised NN architectures. Therefore, suitable combinations of LVQ and RBF NN architectures, synthesized in a multinet architecture, are expected to achieve high diagnostic performance and generalization capabilities, offering also the advantage of simpler design and training compared to the classical MLP NN approaches.

There exist a number of different possible schemes for the above synthesis of different NN architectures and the design of a multinet architecture. A voting scheme, based on the idea of the 'Majority Rule' proposed in [6], was developed in order to make the final decision regarding the gas turbine condition, when a number of different architectures-classifiers (voters) are used in parallel. The structure of this multinet architecture is shown in Fig. 16 when three independent NN classifiers, each trained to classify patterns from a specific instrument, are synthesized in a voting scheme. As it can also be seen from Fig. 16, according to the majority rule the gas turbine condition is assigned to class  $i$  if the majority (at least two) of the classifiers 'vote' for this class, i.e. classify their input pattern to class  $i$ .

By examination of the results of the previous sections, it was found that the synthesized use of the schemes "MLVQ", "A3/LVQ" and "B/RBF", in a multinet architecture based on the majority rule results in 100% success for all classes, when the initial training set of 63 patterns is used. This is shown in Fig. 17, where we can see the classification success rates obtained over the complete pattern set for the five different pattern classes with each of the three classifiers-voters and also with this multinet architecture.

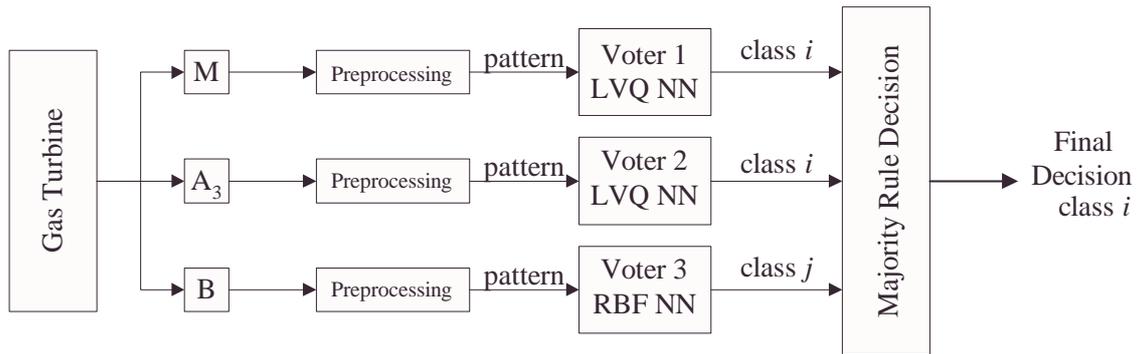


Figure 16. The Multinet architecture

Next the smaller training set of 54 patterns that was previously described for the “A2/Modular” scheme was used for the training of each of the voters “M/LVQ”, “A3/LVQ” and “B/RBF”. The classification success rates obtained over the complete pattern set for the five different pattern classes with each of the three voters and with the multinet architecture are shown in Fig. 18.

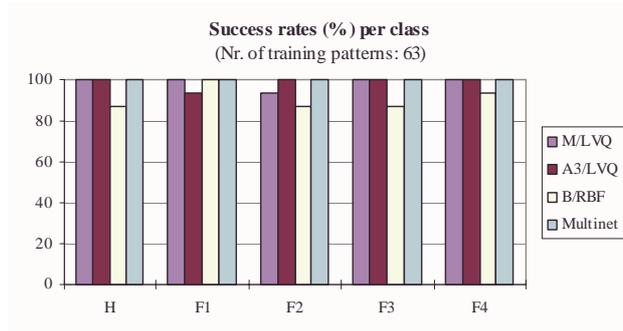


Figure 17. Performance of the three voters and the multinet classifier.

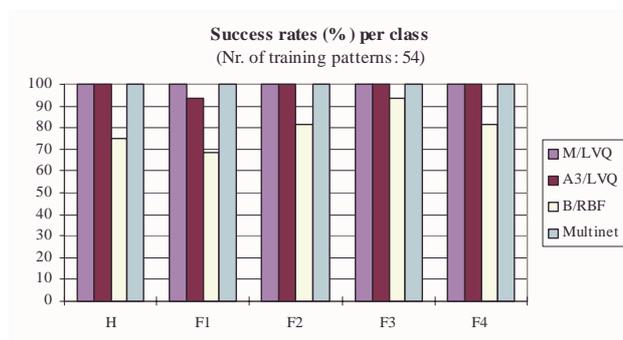


Figure 18. Performance of the three voters and the multinet classifier for a smaller training set.

Therefore, by decreasing the training set the performance of the multinet architecture does not decrease (as in the case of the "A2/Modular" scheme), but is maintained at high levels, achieving a success rate of 100% for all

classes. Conclusively, the multinet architecture achieves superior performance by successfully synthesizing the independent classifiers-voters, resulting in more reliable classifications.

From the above it can be concluded that the proposed multinet architecture provides a useful basis for the development of an automated diagnostic system with high performance, reliability, robustness and generalization capabilities with small training sets. It should also be mentioned that these features are achieved with a small number of easy to implement measurements, a matter of great practical importance in the industrial reality.

## 7. Conclusions

Initially a number of classical neural network architectures have been evaluated for the Gas Turbine Blading Fault Diagnosis problem, which is regarded to be one of the most critical and at the same time difficult diagnostic problems, for 12 measuring instruments and 4 typical blading faults. As criteria for this evaluation were considered a number of issues, such as structural simplicity, training algorithm effectiveness and overall performance (success rates and generalization capabilities).

The MLP architecture relies critically on the experimental selection of a number of design parameters. The success rates of the MLP architecture are found to be satisfactory in the training set, but the generalizing abilities of this architecture are inadequate. The LVQ architecture offers the advantage of a very simple topology. Also because of the absence of a hidden layer and the uniquely defined competitive output layer, there is no need of an experimental network design. The generalizing ability of successfully trained LVQ network structures is found to be very good. On the other hand LVQ, being an algorithm allowing for self-organization, is not successful for less severe faults even for the training set patterns, as it was observed in some cases. The Modular MLP architecture shows improved generalization abilities compared to the original MLP architecture. Finally the RBF architecture, trained by the OLS algorithm, offers the advantage of a short design procedure. The success rates of the RBF architecture are satisfactory over the training set, but it shows an overall poor generalization performance in the

high dimensional pattern space of the present diagnosis problem.

In order to improve the generalization abilities shown by the above classical architectures, a new multinet architecture was developed. As criteria for the design of this multinet architecture were used the maximization of diagnostic performance and the minimization of the total instrumentation cost. A multinet classifier based on the idea of the 'Majority Rule' decision was developed, as a combination of two LVQ and one RBF network architectures based on instruments A3, M and B, respectively. The results obtained using this multinet architecture were very promising, showing that it can provide a useful basis for an automated diagnostic system of high accuracy, reliability, generalization capabilities and robustness to variations of training data. Further research is conducted toward the development of a systematic multinet classifiers design methodology, for the selection of the appropriate neural network architectures and measuring instruments to be used as the basis of an automated diagnostic system with desirable characteristics.

## References

- [1] E. Loukis, P. Wetta, K. Mathioudakis, A. Papathanasiou, K. Papailiou, 'Combination of Different Unsteady Quantity Measurements for Gas Turbine Blade Fault Diagnosis', *36th ASME International Gas Turbine and Aeroengine Congress*, Orlando, 1991, ASME paper 91-GT-201.
- [2] E. Loukis, *Contribution to Gas Turbine Fault Diagnosis Using Methods of Fast Response Measurement Analysis*, Doctoral Thesis, Athens, National Technical University of Athens, 1993.
- [3] G. Merrington, O. K. Kwon, G. Godwin, B. Carlsson, Fault Detection and Diagnosis in Gas Turbines, *ASME Journal of Engineering for Gas Turbines and Power*, 113, 1991, 11-19.
- [4] E. Loukis, K. Mathioudakis, K. Papailiou, A procedure for Automated Gas Turbine Blade Fault Identification Based on Spectral Pattern Analysis, *Journal of Engineering for Gas Turbines and Power*, 114, 1992, 201-208.
- [5] E. Loukis, K. Mathioudakis, K. Papailiou, Optimizing Automated Gas Turbine Fault Detection Using Statistical Pattern Recognition, *Journal of Engineering for Gas Turbines and Power*, 116, 1994, 165-171.
- [6] Roberto Battiti and Anna Maria Colla, Democracy in Neural Nets: Voting Schemes for Classification, *Neural Networks*, 7, 4, 1994, 691-707.
- [7] A. D. Pouliezios and G. S. Stavrakakis, *Real Time Fault Monitoring of Industrial Processes*, Dordrecht, Kluwer Academic Publishers, 1994.
- [8] Robert Schalkoff, *Pattern Recognition: Statistical, Structural and Neural Approaches*, New York, Wiley, c1992.
- [9] Simon Haykin, *Neural Networks: A Comprehensive Foundation*, New York, Maxwell-Macmillan, 1994.
- [10] Rangarchi Anand, Kishan Mehrotra, Chilukuri K. Mohan and Sanjay Ranka, Efficient Classifications for Multiclass Problems Using Modular Neural Networks, *IEEE Transactions on Neural Networks*, 6, 1, 1995, 117-124.
- [11] Christopher M. Bishop, *Neural Networks for Pattern Recognition*, Oxford, Clarendon Press, 1995.
- [12] S. Chen, C.F.N. Cowan, and P.M. Grant, Orthogonal Least Squares Learning Algorithm for Radial Basis Function Networks, *IEEE Transactions on Neural Networks*, 2, 2, 1991, 302-309.

## Biographies



*Costantinos Angelakis* received the Diploma in electrical engineering from the National Technical University of Athens, Greece, in 1994 and the M. S. degree in electronic and computer engineering from the Technical University of Crete, Chania, Crete, Greece, in 1997. He is currently working toward the Ph.D. degree in electronic and computer engineering at the Technical University of Crete.

He has been working as a post graduate researcher at the Telecommunication Systems Institute of the Technical University of Crete since 1995. His research interests include neural networks, fault diagnosis with intelligent systems, image compression, and computer networks.



*Euripidis N. Loukis* received the Ph.D. degree in mechanical engineering from the National Technical University of Athens, Greece, in 1993. He is a Visitor Assistant Professor of Information Systems at the Department of Information and Communication Systems, University of Aegean. Formerly, he was Visitor Assistant Professor at the Department of Industrial Engineering,

University of Thessaly, and Professor at the National Academy of Public Administration. Also he is an Information Systems Advisor at the Ministry to the Presidency of Government of Greece, National Representative of Greece in the European Union for Transeuropean Administration Networks, Expert of the European Union in this area and member of the National Committee for Electronic Commerce. He is the author of several books and articles in the area of management information and decision support systems in the industry and in the public administration. One of his articles has been awarded in May 1993 the International Prize of the American Society of Mechanical Engineers – Control and Diagnostics Committee.



*A. Pouliezios*, Associate Professor, Dept. of Production and Management Engineering, Technical University of Crete, Greece. Born in Athens, Greece in 1951. BSc. in Computing and Mathematics from Polytechnic of North London, London, 1975, MSc. in Control Systems from Imperial College, London, 1976, Ph.D. from Brunel University in

1980. His research interests include fault diagnostics, bio-modeling, intelligent systems and control, control education. He is a member of IEEE and TEE (Greece).



*G. S. Stavrakakis*, Full Professor, Dept. of Electronic and Computer Engineering, Technical University of Crete, Greece. Born in Crete, Greece in 1956. Received his first degree in Electrical Engineering from N.T.U.A. (National Technical University of Athens), Athens, in 1980. His D.E.A. in Automatic Control and Systems Engineering was obtained from I.N.S.A., Toulouse, in 1981 and his Ph.D. in the same area was

obtained from "Paul Sabatier" University, Toulouse, in 1984. He has worked as a Research Fellow in the Robotics Laboratory of N.T.U.A. (1985-1988), and as a Visiting Scientist at the Institute for System Engineering and Informatics/Components Diagnostics & Reliability Sector of the EEC - Joint Research Centre at Ispra, Italy (1989-1990). His research interests include industrial and space technology applications of control and estimation theory, production systems automation, robotics, neural networks and fuzzy logic technology, decision analysis for process reengineering, systems safety and reliability analysis, real-time industrial processes fault monitoring and diagnosis, alternative sources of energy modeling and automation. He is the author and co-author of about seventy full papers in international journals and conferences, twelve research reports and two books on the above topics.